

MAHARASHTRA STATE ELECTRICITY TRANSMISSION CO. LTD.

Name of Office	: 400 KV R.S O&M Dn. Karad.
Office Address	: Administrative Building, Ground Floor, Vijaynagar, Post – Supane, Tal – Karad Dist – Satara, Pin No. 415114
Contact No.	: 02164-255182 Fax. No. 02164-255182
Email ID	: ee3130@mahatransco.in
Website	: www.mahatransco.in .
CIN No.	: U40109MH2005SGC153646

No.EE/400KV RS O&M/DN/KRD/T/No

No 0 0 5 7 4

Date :

14 DEC 2020

TO WHOM SO EVER IT MAY CONCERN

BUDGETARY OFFER

Please find herewith a detail schedule as per the following for Supply of 54 KV over 39 KV, 10 KA Metal Oxide Surge Arrestor at 400 KV R.S. Karad.

All interested & experienced bidders are requested to submit their best lowest budgetary offer on the Mail ID: ee3130@mahatransco.in for the same upto Dtd.21.12.2020. Taxes should be quoted distinctly if any.

Please note that this budgetary offer is for estimation purpose only.




Sr. No.	Description of Material	Unit	Approx Qty.	Rate per unit in Rs.	Total Amount
01	Supply of 54 KV, 10 KA Stn MO gapless surge arrestor.	EA	08	---	---
02	Supply of 39 KV, 10 KA Stn MO gapless surge arrestor.	EA	08	---	---

The material should be procured from approved MSETCL vendor for above mentioned material. The approved drawing is attached as per following details.

Encl :- Approved Drawing.

MF(O).
14122020


(Vijaykumar H. Patil)
Executive Engineer (Charge)
400 KV R.S.(O&M)Dn.Karad

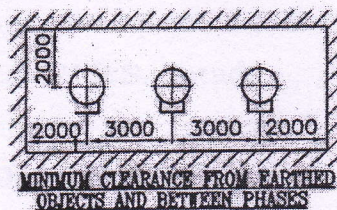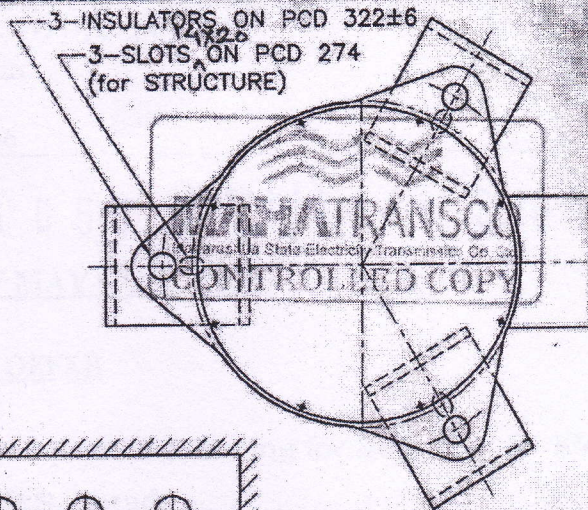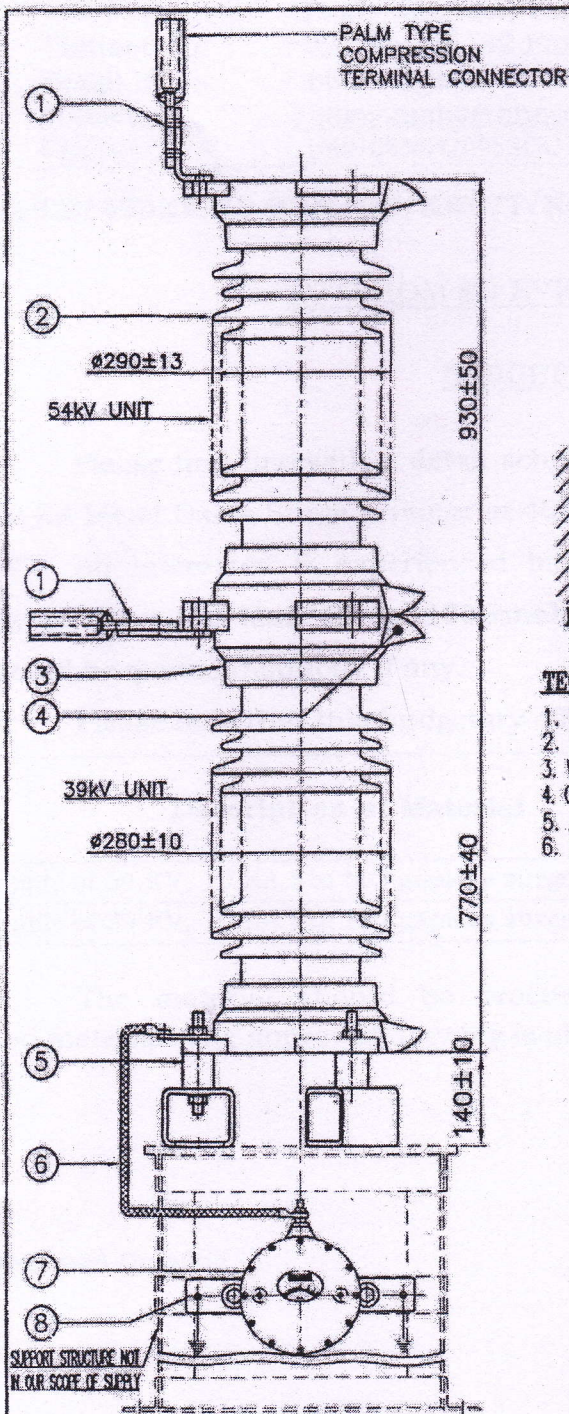

ARRESTER BASE MOUNTING DETAILS

TECHNICAL DETAILS:

1. PRESSURE RELEASE CLASS : A (40ka)
2. LONG DURATION DISCHARGE CLASS : 3.
3. WEIGHT : FOR 39kV ARRESTER : 30Kgs.±10%; 54kV ARRESTER : 62Kgs.±10%
4. CREEPAGE DISTANCE : FOR 39kV : 1050mm MIN. & 54kV : 1800mm MIN.
5. ARRESTER SUITABLE FOR HOT LINE WASHING
6. ARRESTER HOUSING : PORCELAIN TYPE

VERIFIED BY	
CHECKED BY	<i>[Signature]</i>

APPROVED

8. FARTHING & FIXING TERMINAL
7. SURGE MONITOR
6. CONNECTING LEAD-35sq.mm AL CABLE 1.5M LENGTH AT TUGS, AT ENDS
5. INSULATING BASE
4. PRESSURE RELEASE PORCELAIN
3. END CASTING
2. ARRESTER HOUSING
1. PALM TYPE TERMINAL CONNECTOR

TITLE:
54kV-10kA OVER 39kV-10kA METAL-OXIDE SURGE ARRESTERS
 DRG. No.: **ZAQ-5439135-SM** DRN. BY: *[Signature]*
 SCALE: N.T.S. APPRD. BY: *[Signature]*
 ALL DIMENSIONS ARE IN m.m.

MATL: ALL M.S. PARTS ARE HOT DIP GALVANIZED
 REV. No.: 0 DATE: 14/10/2014
 OBLUM ELECTRICAL INDUSTRIES PRIVATE LIMITED
 A-16&17 ASSISTED PRIVATE INDUSTRIAL ESTATE
 BALANAGAR
 HYDERABAD - 37 A.P. (INDIA)

